

**Physical Address:**

CRANE Instrumentation & Sampling  
 405 Centura CT,  
 Spartanburg, SC 29303-6603  
 Phone: (864) 574-7966  
 Fax: (864) 587-5608  
 Email: [Click Here](#)

**Mailing Address:**

HOKE  
 PO Box 4866,  
 Spartanburg, SC 29305-4866



## Item # HM823222P8HCGAM8, Remote Mount 2-Valves Manifolds (With 1/2" Intregal GA Adapter), Model-HM82GAM8

**Using the 2-valve manifold**

In normal operation the "isolate" valve is open while the "vent" valve is closed.

To remove the instrument, first close the "isolate" valve, then open the "vent" valve to relieve pressure upstream of the "isolate" valve.

Note: The body & trim parts on all 316/316L Valves & Manifolds comply to NACE MR-01-75 & NORSOK M-650 as standard.

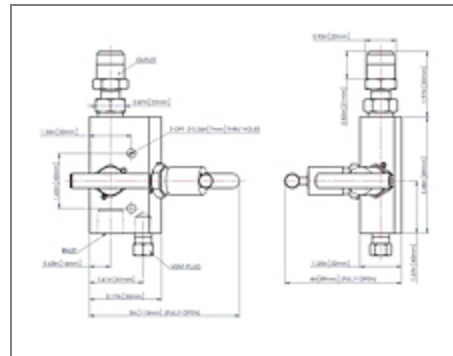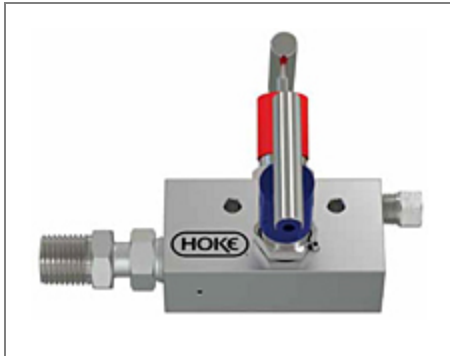

[Specifications](#) | [Calibration Option](#) | [Pressure Equipment Directive](#)

### Specifications

<b>Type</b>	Remote
<b>Fixed</b>	2
<b>Tip</b>	Soft
<b>Packing</b>	GRAFOIL
<b>Inlet Connection</b>	Socket Weld
<b>Inlet Size</b>	1/2"

<b>Alloy</b>	HASTELLOY C276
--------------	----------------

<b>Weight</b>	3.3 lb 1.5 kg
---------------	------------------

<b>Maximum pressure at 212 °F (100 °C)</b>	6000 psi 413 bar
--	---------------------

<b>Maximum pressure at 842 °F (450 °C)</b>	3300 psi 230 bar
--	---------------------

#### Calibration Option

By connecting a calibration gauge to the vent port, it is possible to check the calibration of the instrument without removing it from the installation.

#### Pressure Equipment Directive

Due to internal bore size and internal volumes up to and including 1"/25mm, products offered in this catalogue comply with S.E.P (Sound Engineering Practice) article 3, paragraph 3 of the Pressure Equipment Directive P.E.D. 97/23/EC and therefore CE marking is not applicable.